


RECEIVING WATER (R-1 and R-2)
 Monitoring (in mg/L)
 Dissolved Trace Metals


Trace Metal	Monitoring Period	R-1	R-2
Arsenic	12/1/94 - 8/23/95	0.001 - 0.002	0.001 - 0.002
Cadmium	12/1/94 - 8/23/95	<0.005	<0.005
Chromium	12/1/94 - 8/23/95	<0.005	<0.005
Copper	12/1/94 - 8/23/95	<0.005	<0.005 - 0.005
Lead	12/1/94 - 8/23/95	<0.002	<0.002
Mercury	12/1/94 - 8/23/95	<0.001	<0.001
Nickel	12/1/94 - 8/23/95	<0.005	<0.005
Selenium	12/1/94 - 8/23/95	<0.001	<0.001
Silver	12/1/94 - 8/23/95	<0.005	<0.005
Thallium	12/1/94 - 8/23/95	<0.002	<0.002
Zinc	12/1/94 - 8/23/95	<0.005 - 0.046	<0.005 - 0.005

pH Measurements at R-1 and R-2

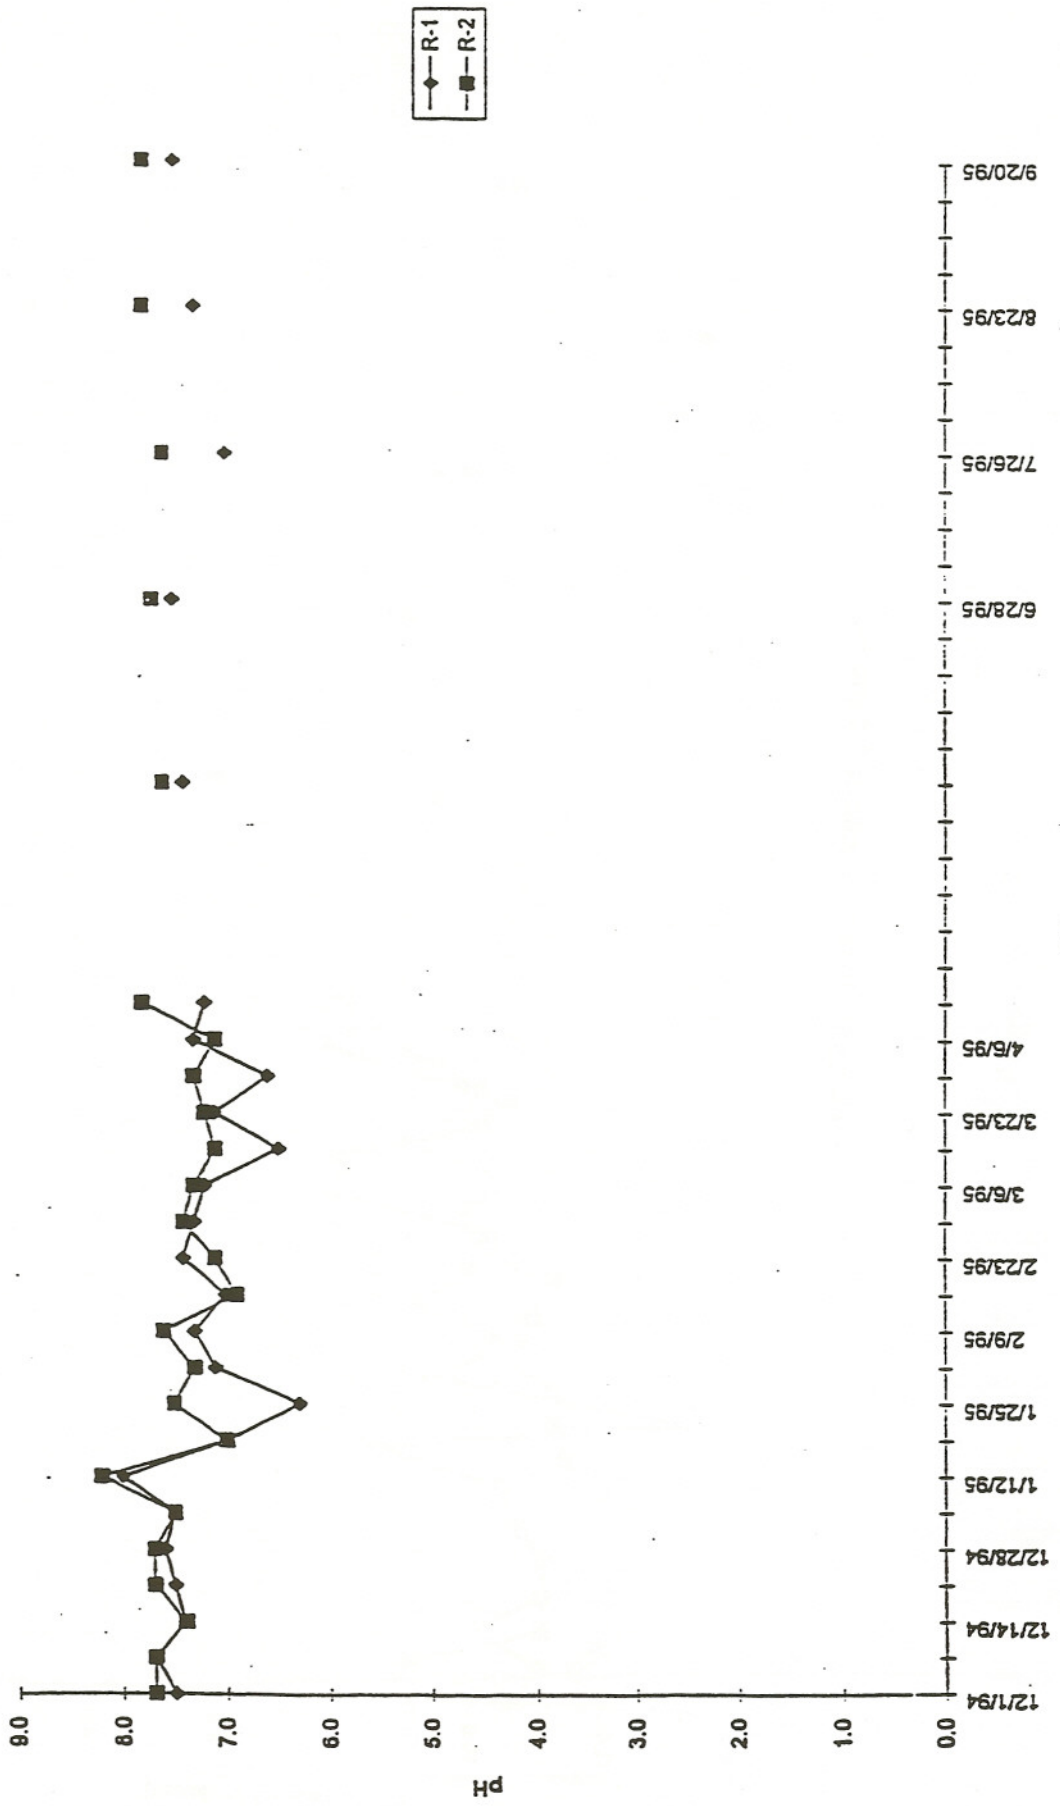


RWOXYGEN Chart 1

Dissolved Oxygen Concentrations at R-1 and R-2

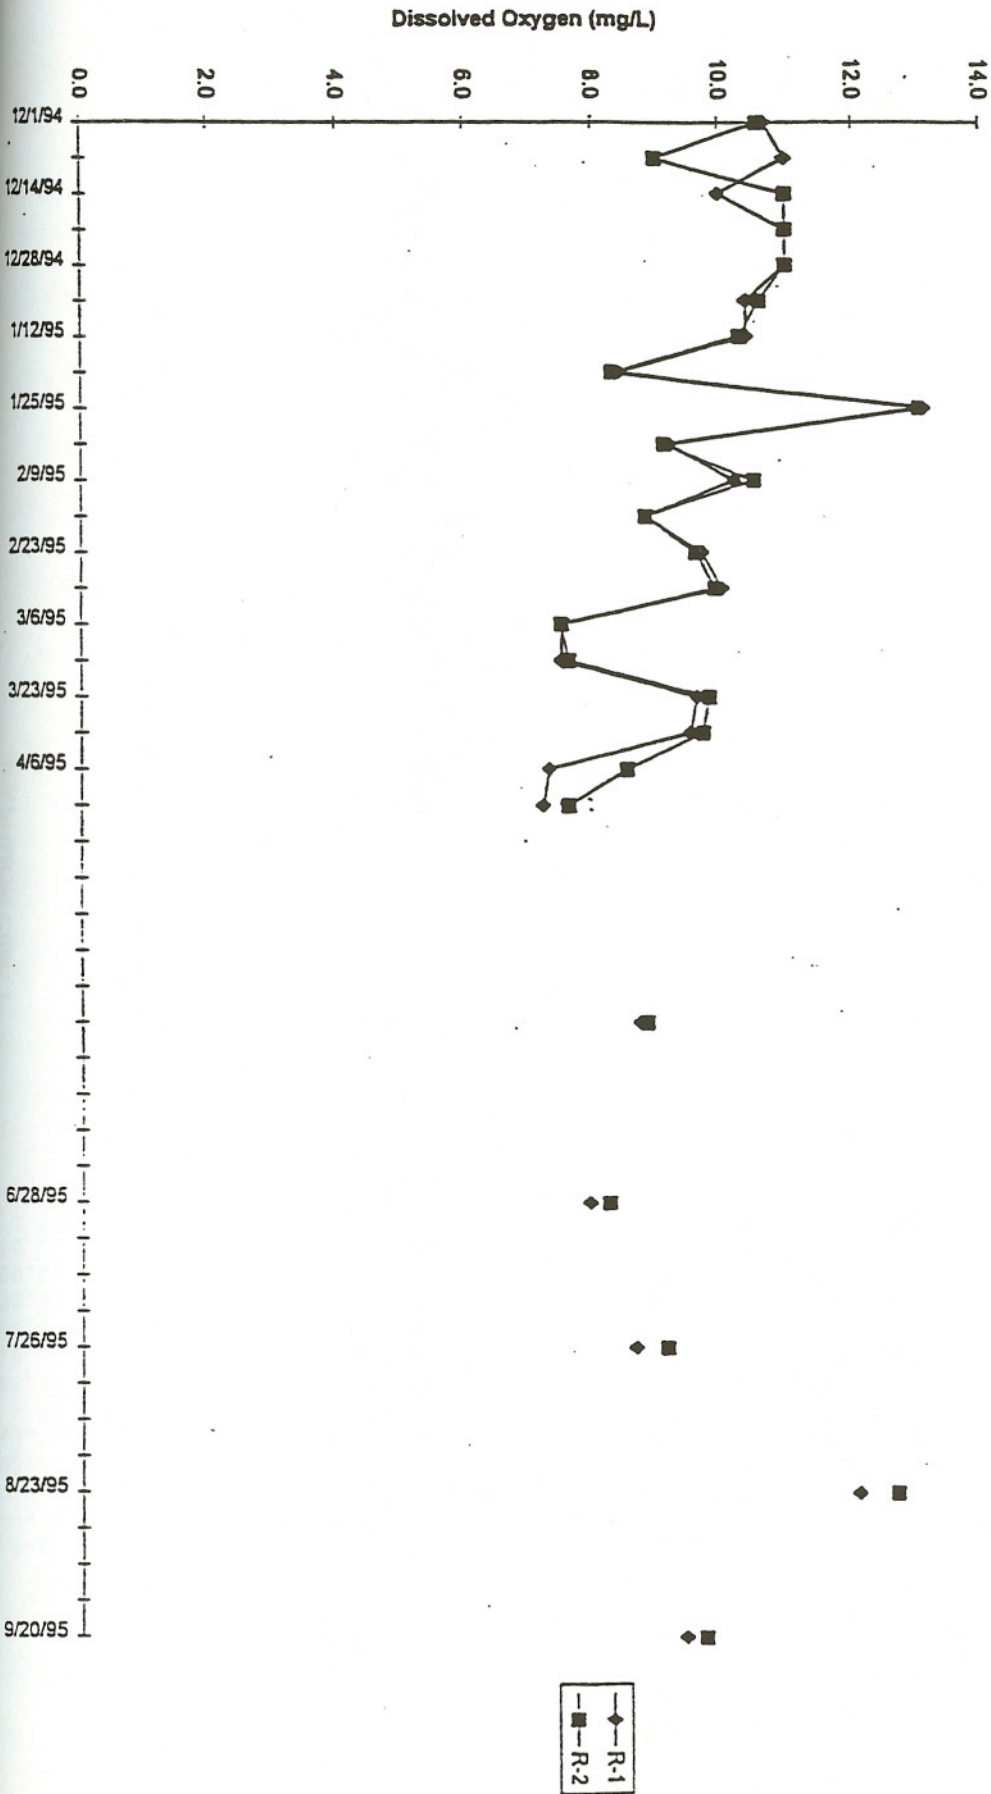


Temperature Measurements at R-1 and R-2

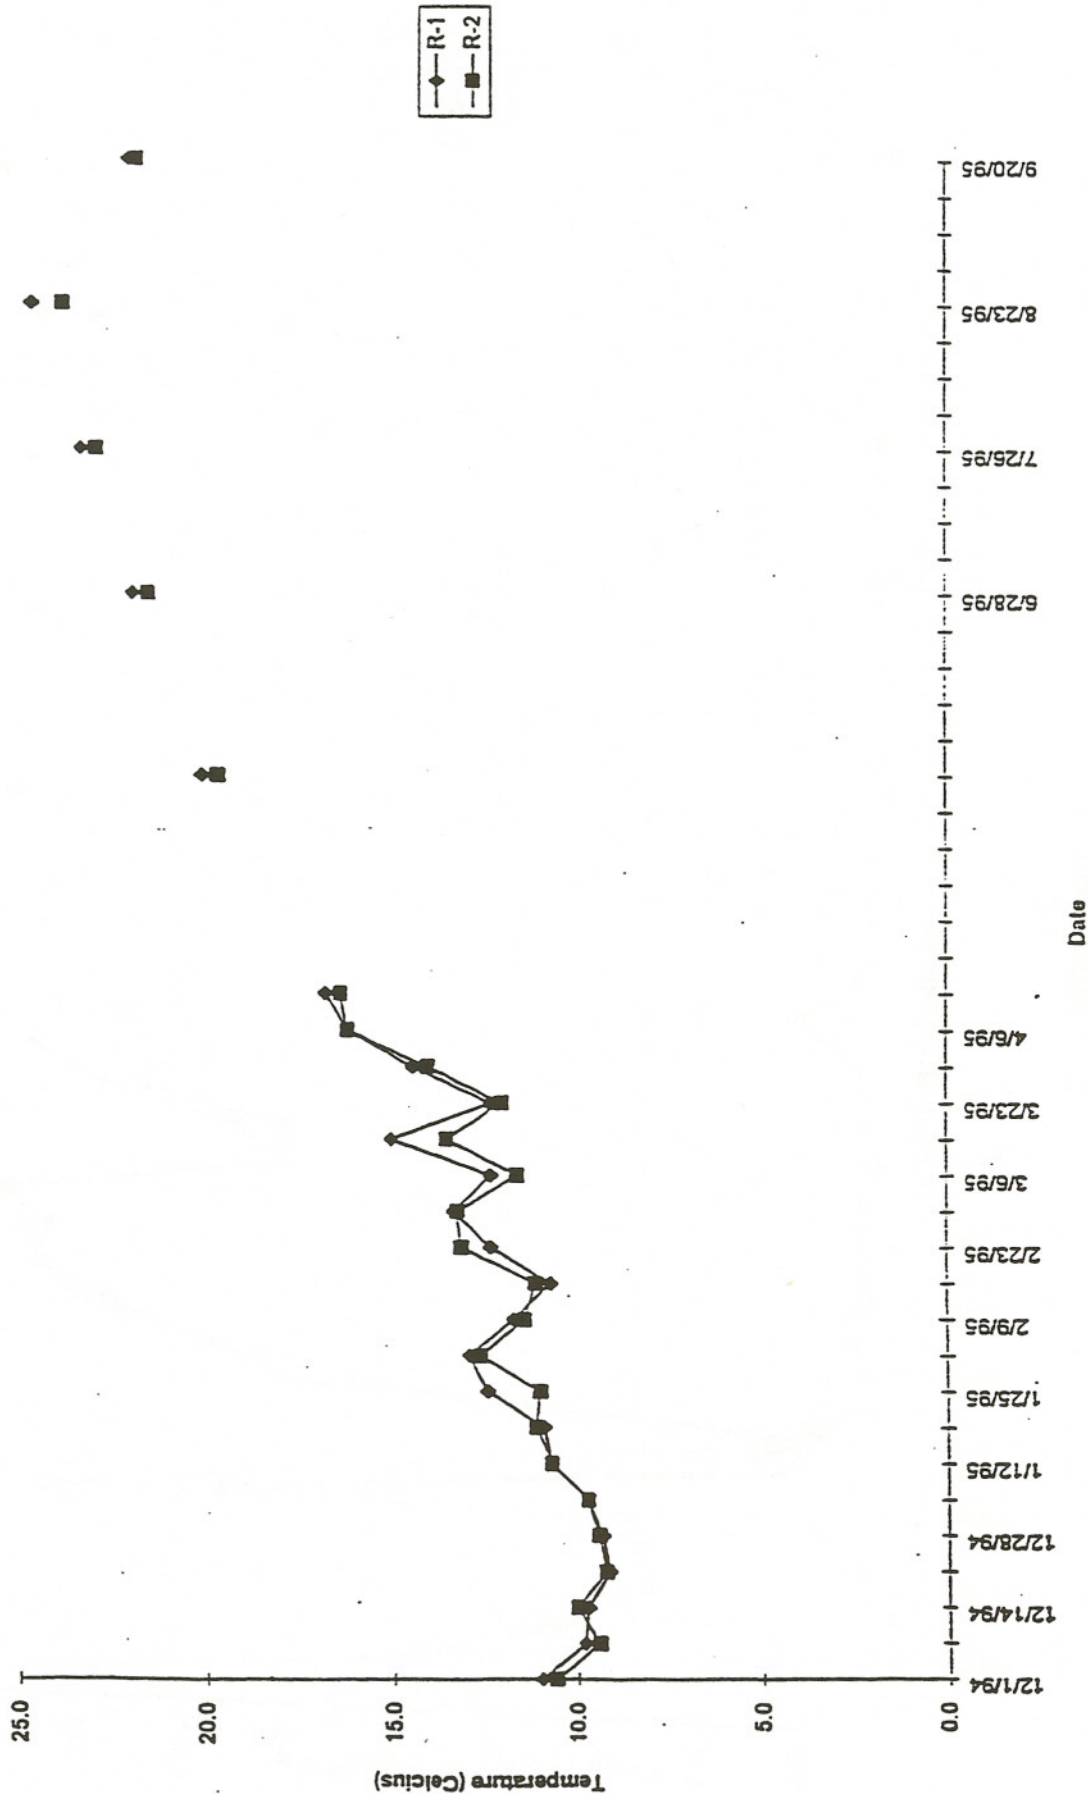


Date

RWTURBID Chart 1

Turbidity Measurements at R-1 and R-2

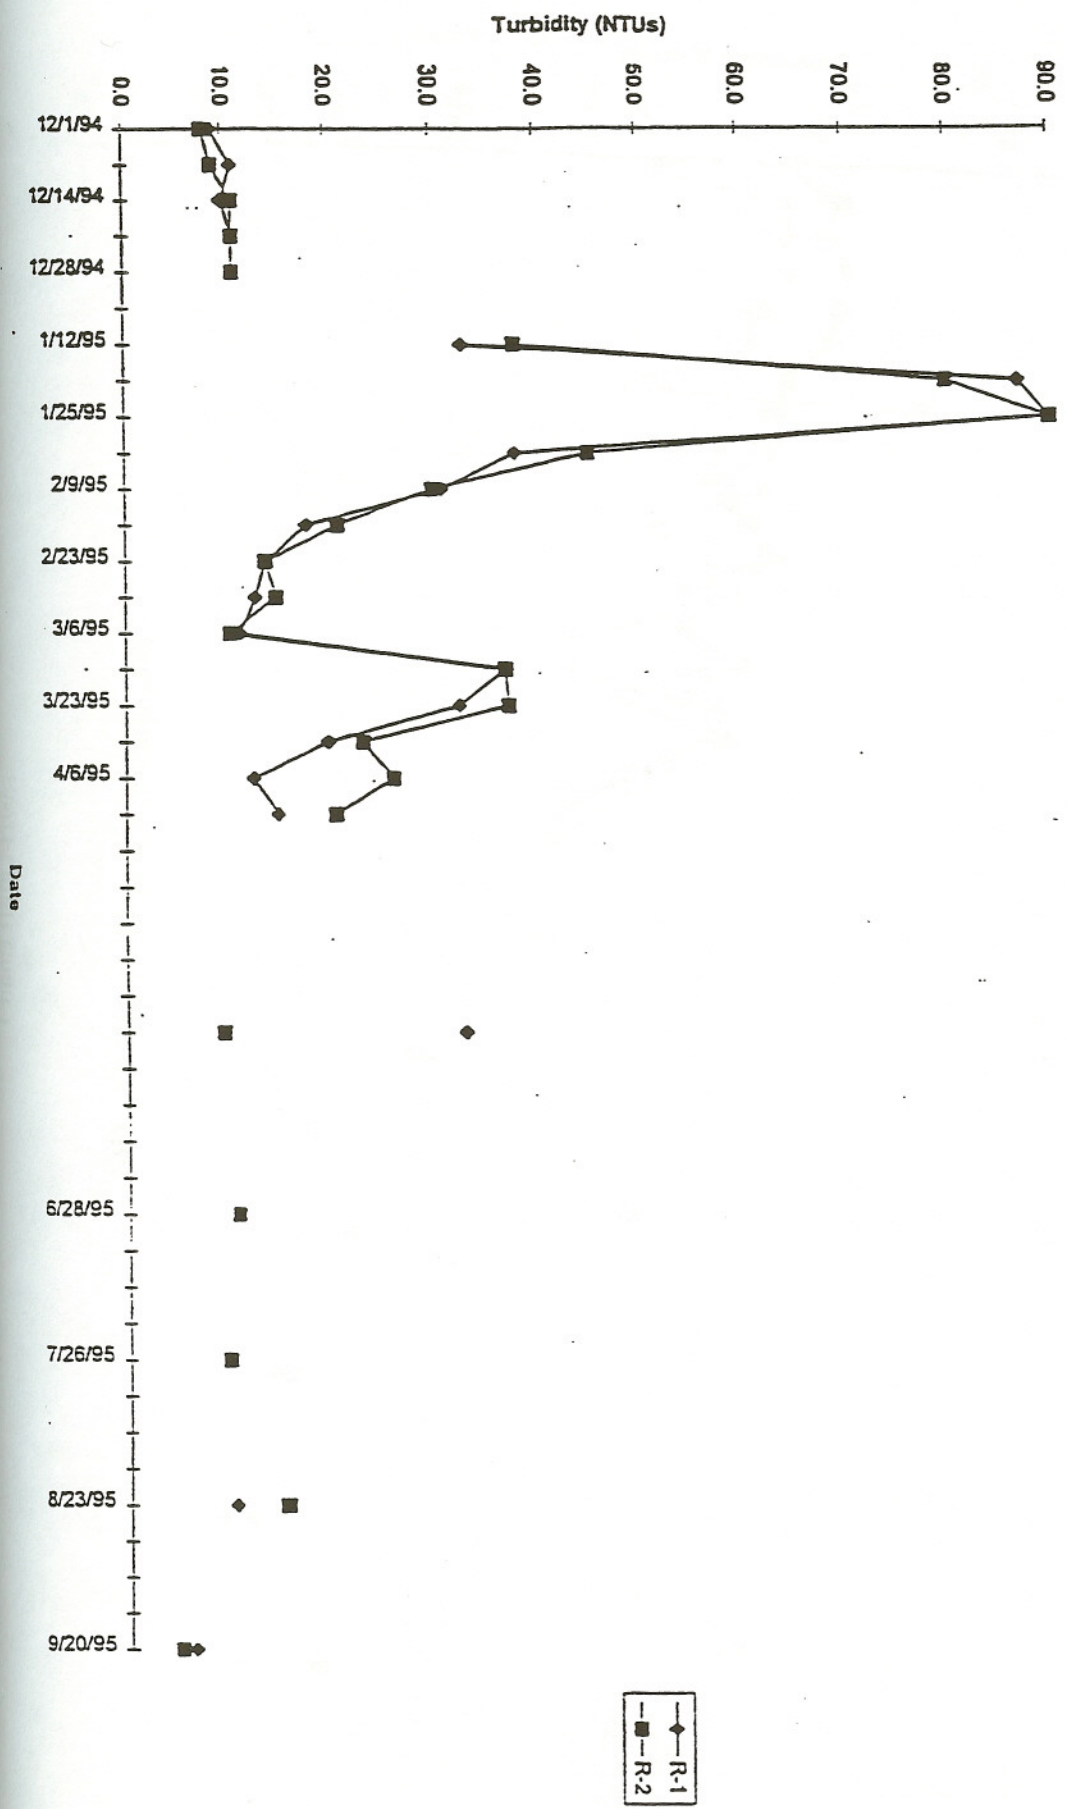


Electrical Conductivity Measurements at R-1 and R-2

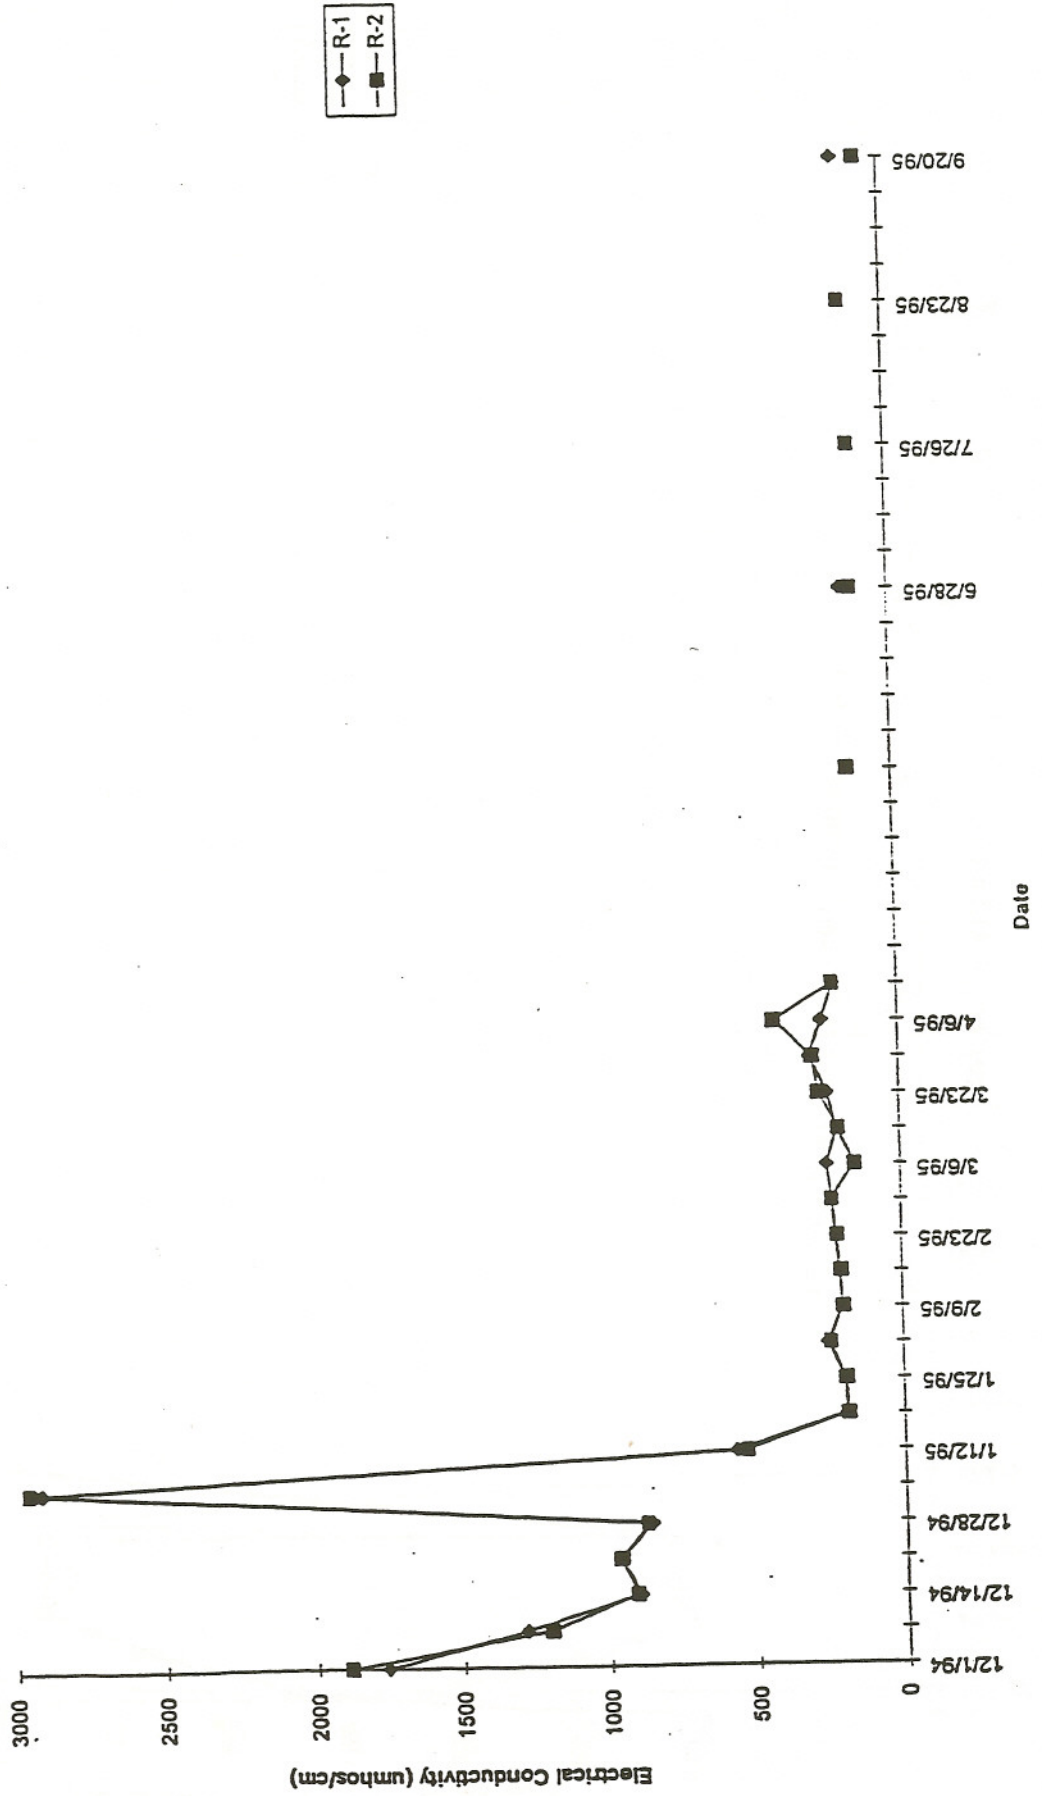


◆ R-1
■ R-2

RWTDSMON Chart 1

Total Dissolved Solids Concentrations at R-1 and R-2

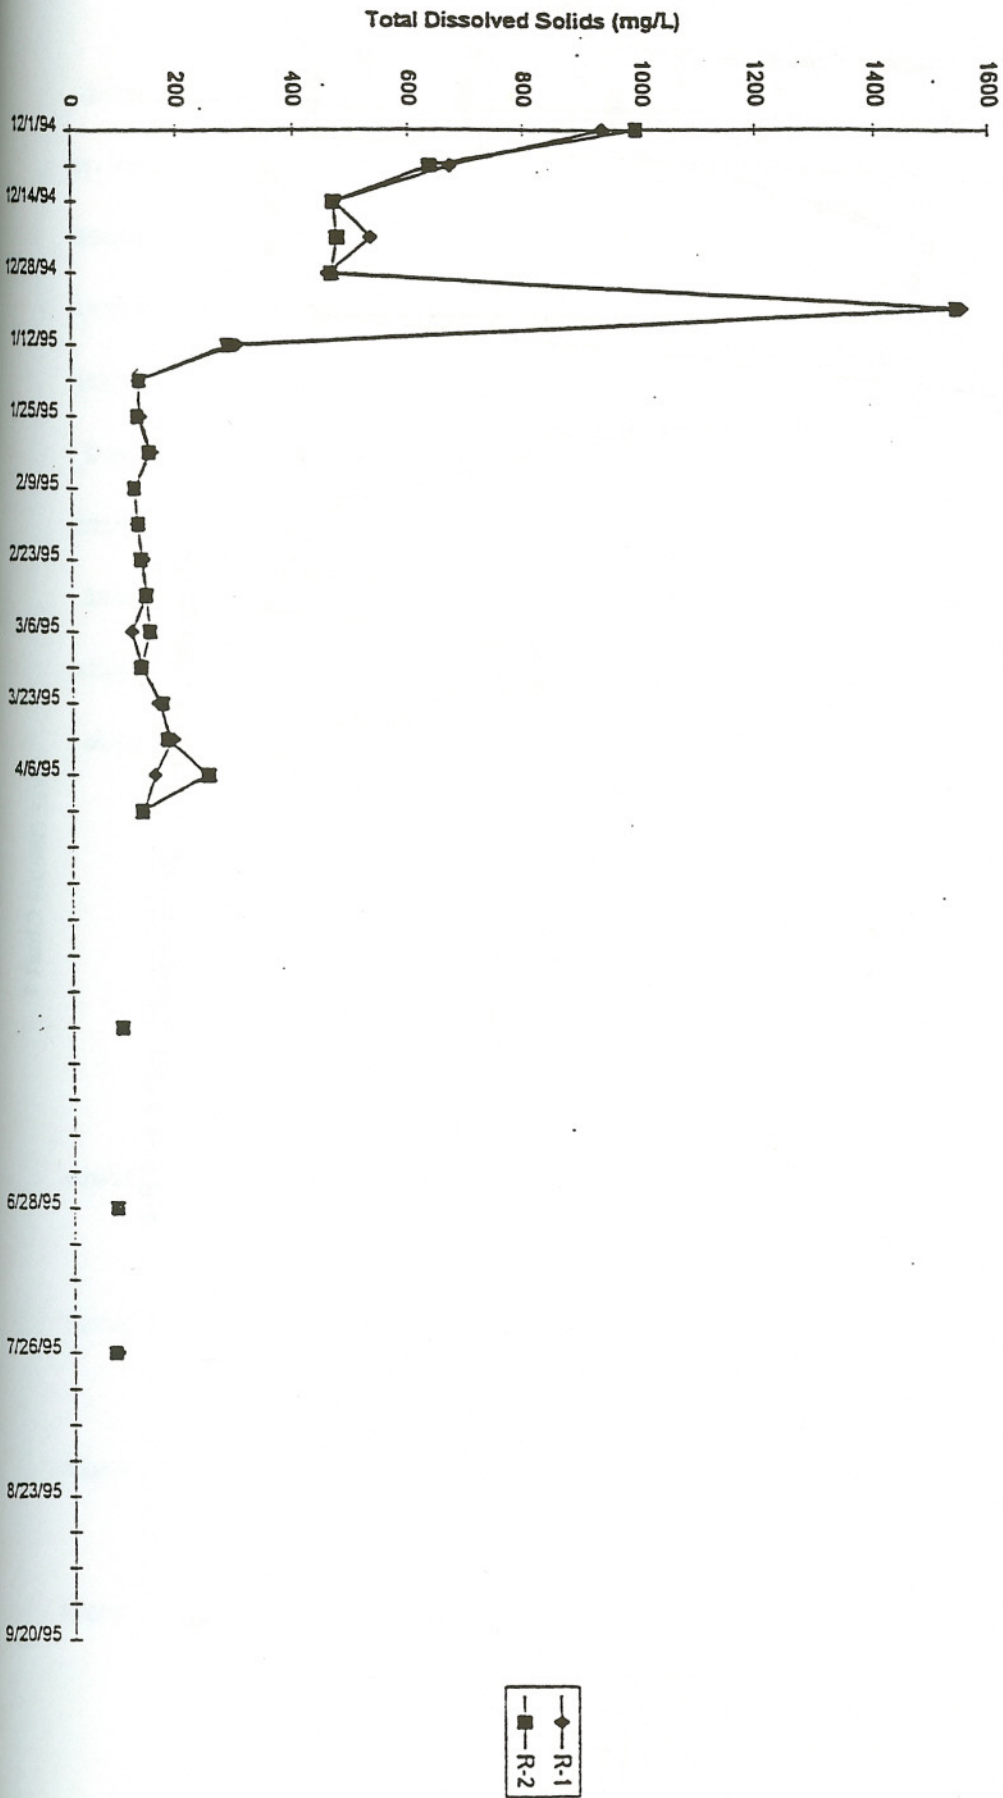


Chloride Concentrations at R-1 and R-2

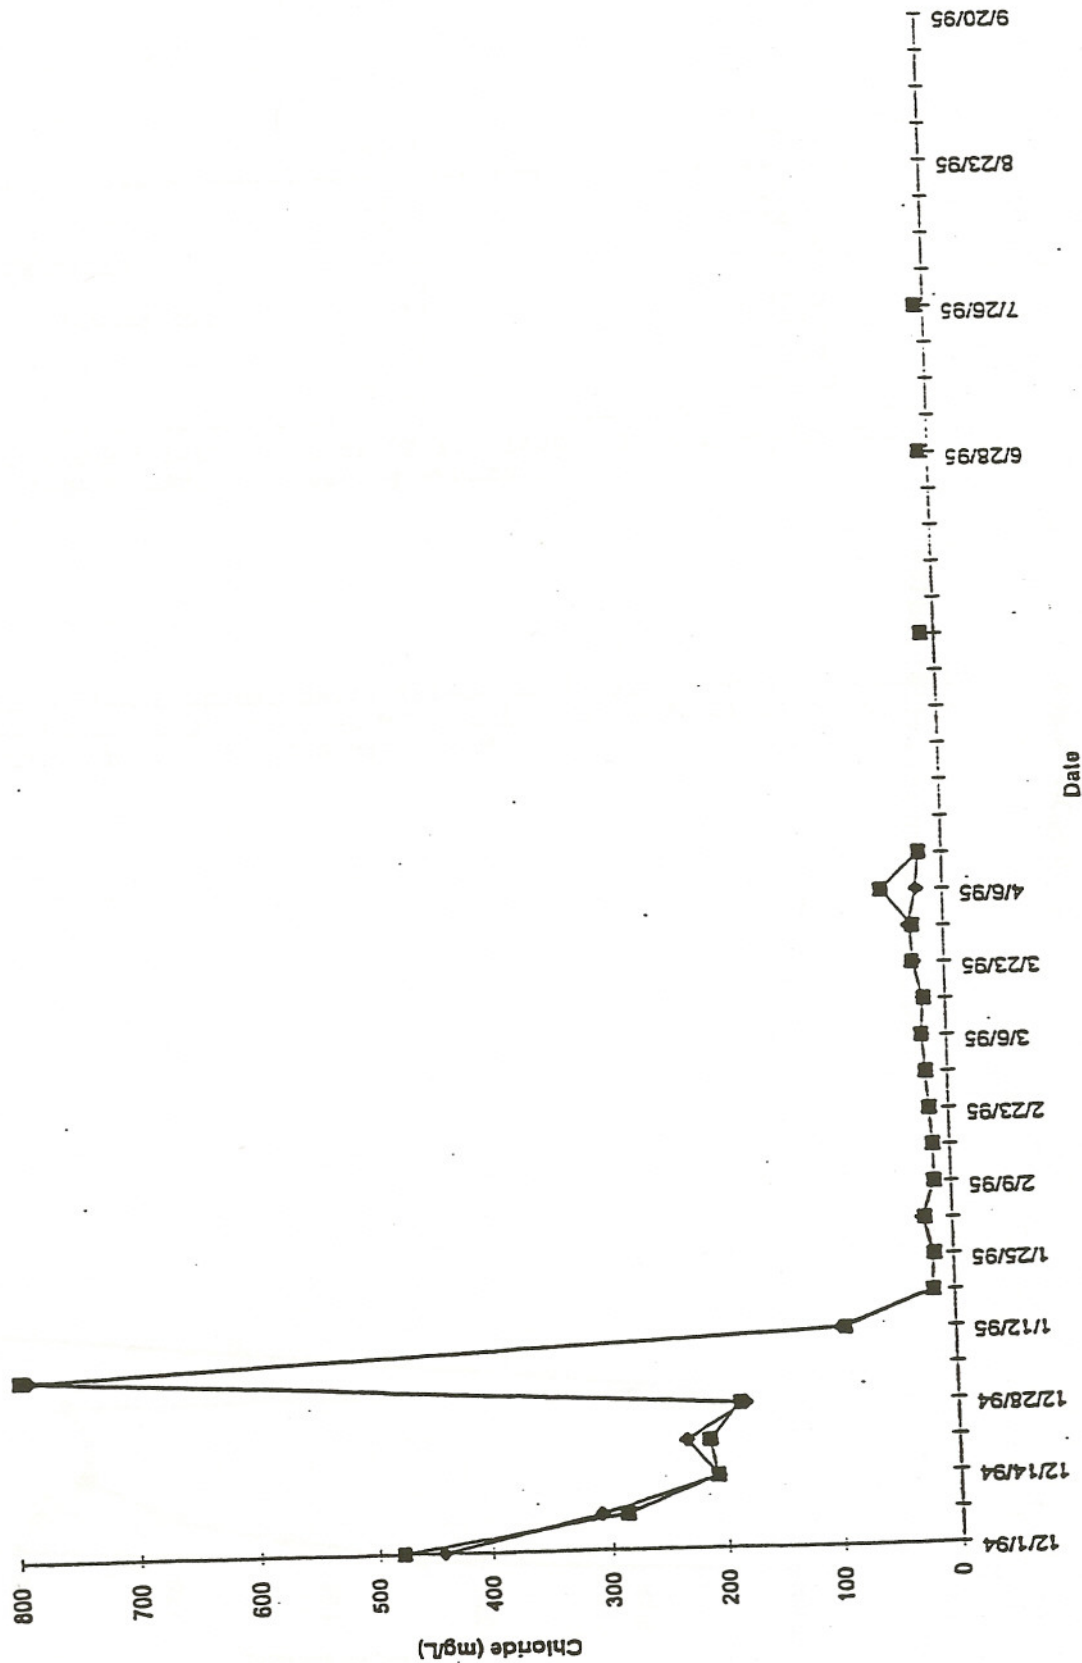

Date

RWBFRMON Chart 1

Bromide Concentrations at R-1 and R-2

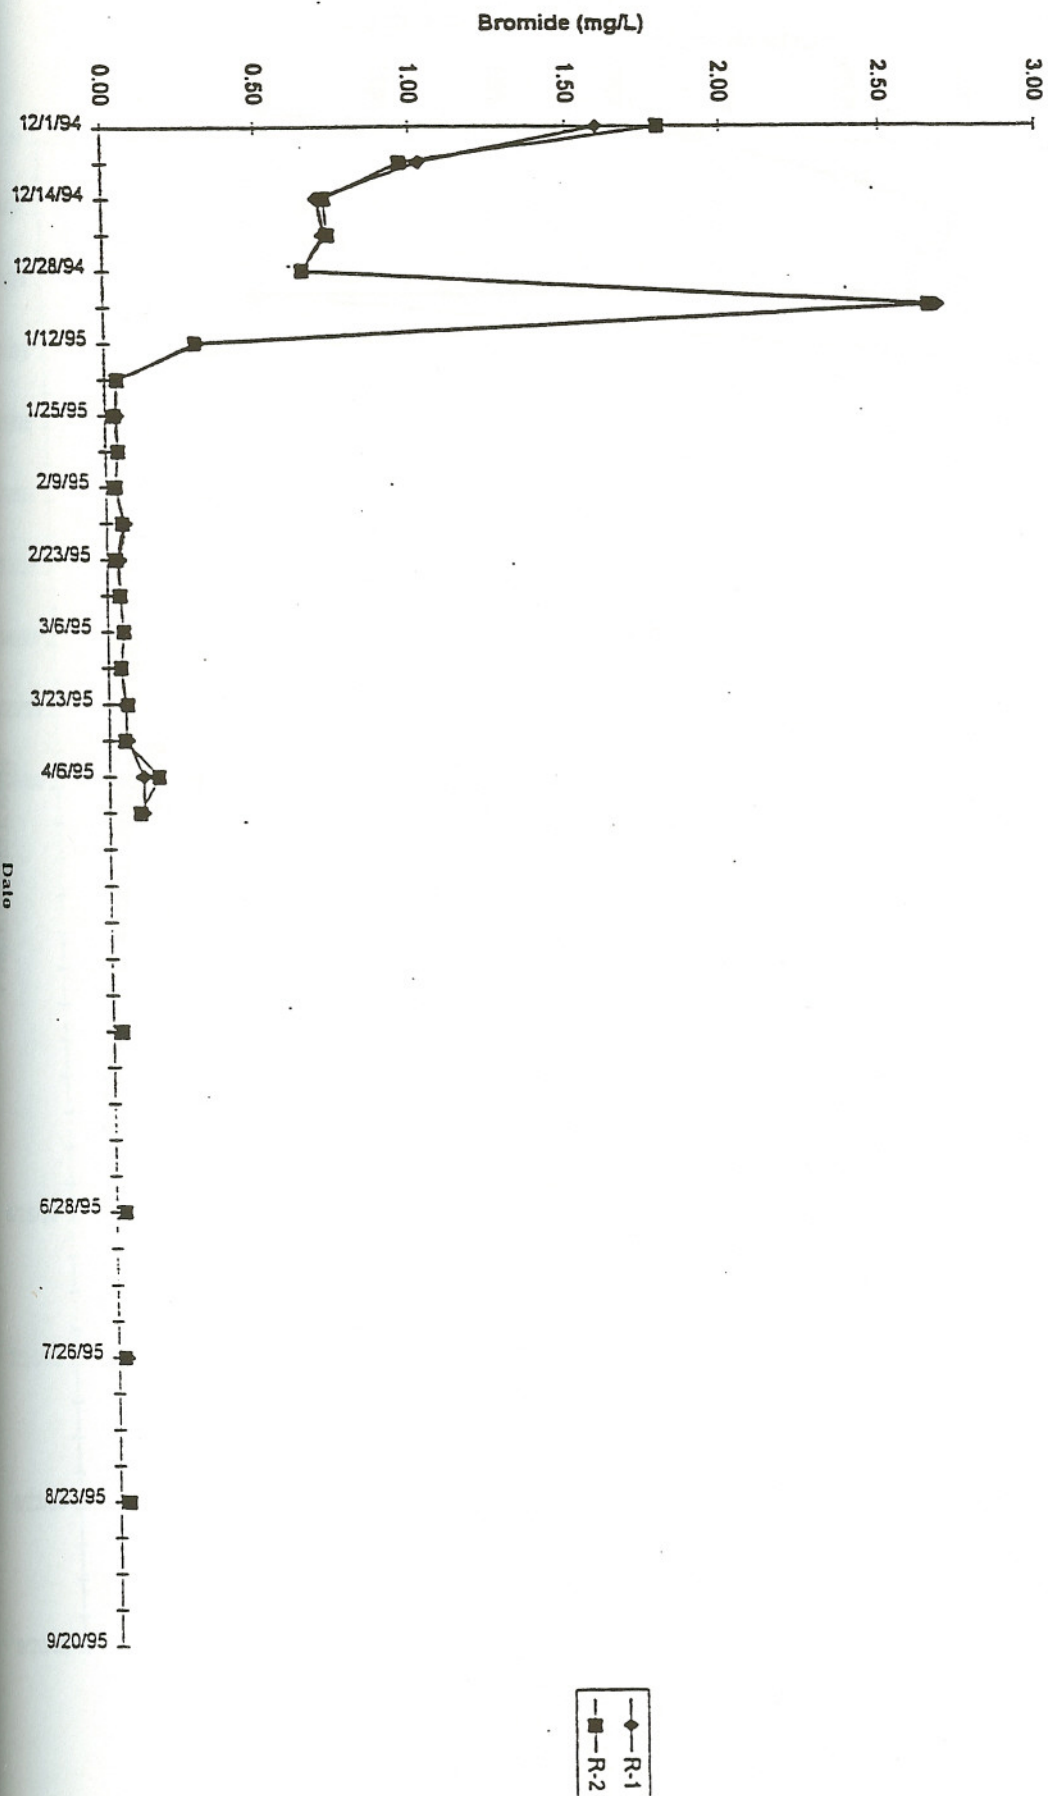

COMPLIANCE POINTS (Ag Drain at MP-1 and CP-1)
Background Data (in mg/L except as noted)
Sampling Date: 11/3/94

Constituent	MP-1	CP-1
Turbidity (NTUs)	7.3	26.5
Dissolved Oxygen	12.8	14.5
Temperature (degrees Celcius)	10.9	10.6
pH (pH units)	7.4	7.9
Electrical Conductivity (umhos/cm)	1508	2330
Total Dissolved Solids	776	1250
Chlorides	311	589
Bromides	1.07	2.16

(Historical Electrical Conductivity data at CP-1: 1400 - 2600 umhos/cm from April 1994 to August 1994 (5 sampling events)).


Dissolved Metals: All concentrations below detection limits except for arsenic, which was 0.005 mg/L at MP-1 and 0.002 mg/L at CP-1; and for zinc, which was 0.005 mg/L at MP-1.

COMPLIANCE POINTS (Ag Drain at MP-1 and CP-1)
 Monitoring (in mg/L except as noted)

Minerals and General Water Parameters	Monitoring Period	MP-1	CP-1
Turbidity (NTUs)	12/1/94 - 9/20/95	8.9 - 46.1	11.1 - 55.0
Dissolved Oxygen	12/1/94 - 9/20/95	3.0 - 11.3	4.1 - 10.5
Temperature (degrees Celcius)	12/1/94 - 9/20/95	8.0 - 24.0	8.8 - 23.0
pH (pH units)	12/1/94 - 9/20/95	6.5 - 8.2	6.6 - 7.6
Electrical Conductivity (umhos/cm)	12/1/94 - 9/20/95	268 - 4,550	163 - 3,850
Total Dissolved Solids	12/1/94 - 8/23/95	50 - 2,680	84 - 2,440
Chlorides	12/1/94 - 8/23/95	36 - 1,160	43 - 839
Bromides	12/1/94 - 9/20/95	0.11 - 4.22	0.14 - 2.26

Dissolved Trace Metals	Monitoring Period	MP-1	CP-1
Arsenic	12/1/94 - 8/23/95	<0.001 - 0.006	0.002 - 0.006
Cadmium	12/1/94 - 8/23/95	<0.005	<0.005
Chromium	12/1/94 - 8/23/95	<0.005	<0.005
Copper	12/1/94 - 8/23/95	<0.005 - 0.011	<0.005 - 0.007
Lead	12/1/94 - 8/23/95	<0.002	<0.002
Mercury	12/1/94 - 8/23/95	<0.001	<0.001
Nickel	12/1/94 - 8/23/95	<0.005 - 0.025	<0.005 - 0.021
Selenium	12/1/94 - 8/23/95	<0.001	<0.001
Silver	12/1/94 - 8/23/95	<0.005	<0.005
Thallium	12/1/94 - 8/23/95	<0.002	<0.002
Zinc	12/1/94 - 8/23/95	<0.005 - 0.047	<0.005 - 0.025

pH Measurements at MP-1 and CP-1

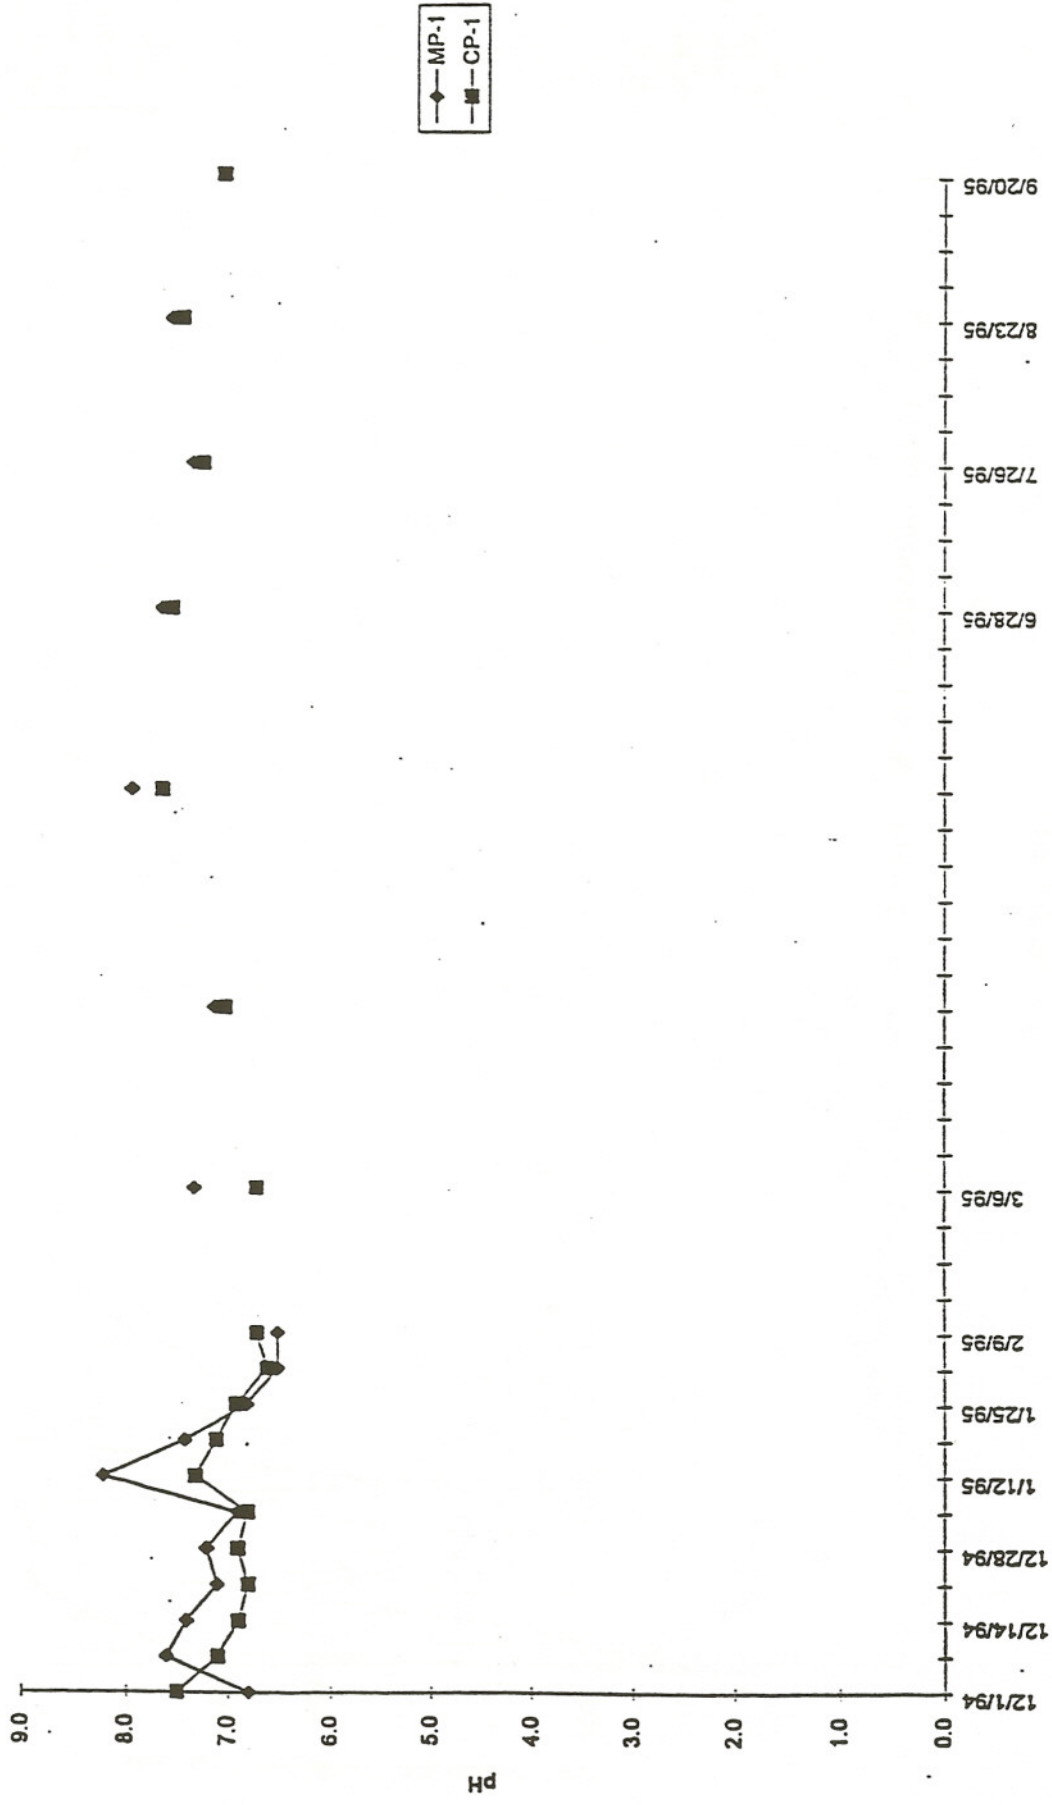

Date